

ALDERWOOD
WATER & WASTEWATER DISTRICT

2025
AWWD Water Use Efficiency Statistics (In Gallons)

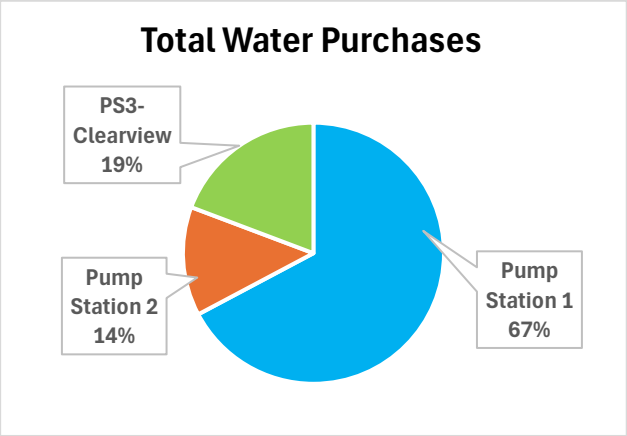

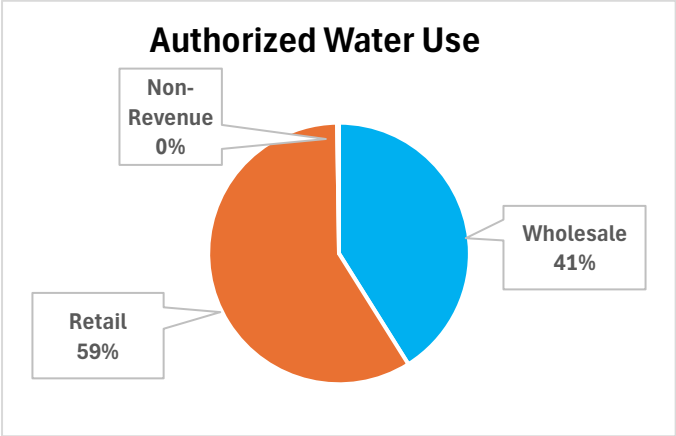

TOTAL WATER PURCHASED	**9,142,552,964**
Pump Station 1	6,148,837,082
Pump Station 2	1,231,565,883
Pump Station 3 - Clearview (AWWD Portion Only)	1,762,150,000
TOTAL AUTHORIZED WATER USAGE	**8,754,627,764**
RETAIL	**5,138,536,752**
Commercial	838,152,619
Multi-Family	1,220,094,506
Single-Family	3,080,289,627
WHOLESALE	**3,595,507,450**
Edmonds	1,030,976,487
Lynnwood	1,305,276,683
Mountlake Terrace	552,164,111
Mukilteo District	497,441,115
Silver Lake District	209,649,054
NON-REVENUE AUTHORIZED	**20,583,563**
Water Quality	2,264,345
Water Division	7,517,387
AWWD Facilities	5,644,052
Snohomish County Fire Districts & Training Facility	2,681,018
Water Use Permits	671,500
CIP Projects	741,698
E&D - Development Services	583,702
Wastewater Division	369,160
DE-New Construction Flushing (Water Only)	110,701
UNACCOUNTED FOR NON-REVENUE	**387,925,200**
	4.24%