



TYPICAL BY-PASS VALVE PLACEMENT

NOTE: BY-PASS VALVE SHALL BE USED WHEN STATIC WATER PRESSURE EXCEEDS 150 P.S.I. ON WATER MAINS 12" AND LARGER.

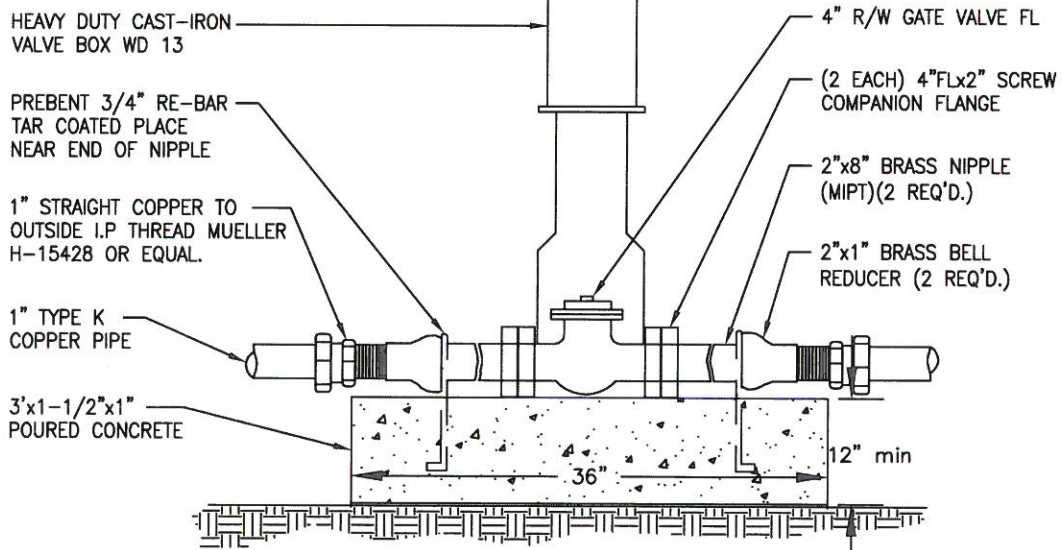

1" CORPORATION STOP

FORD	MUELLER
FB-1000-4-Q	B-25008



ALDERWOOD
WATER & WASTEWATER
DISTRICT

4" BY-PASS VALVE

DATE: 11-2015	DWG. WD-23
APPROVED BY: <u>DLH</u> DISTRICT ENGINEER	