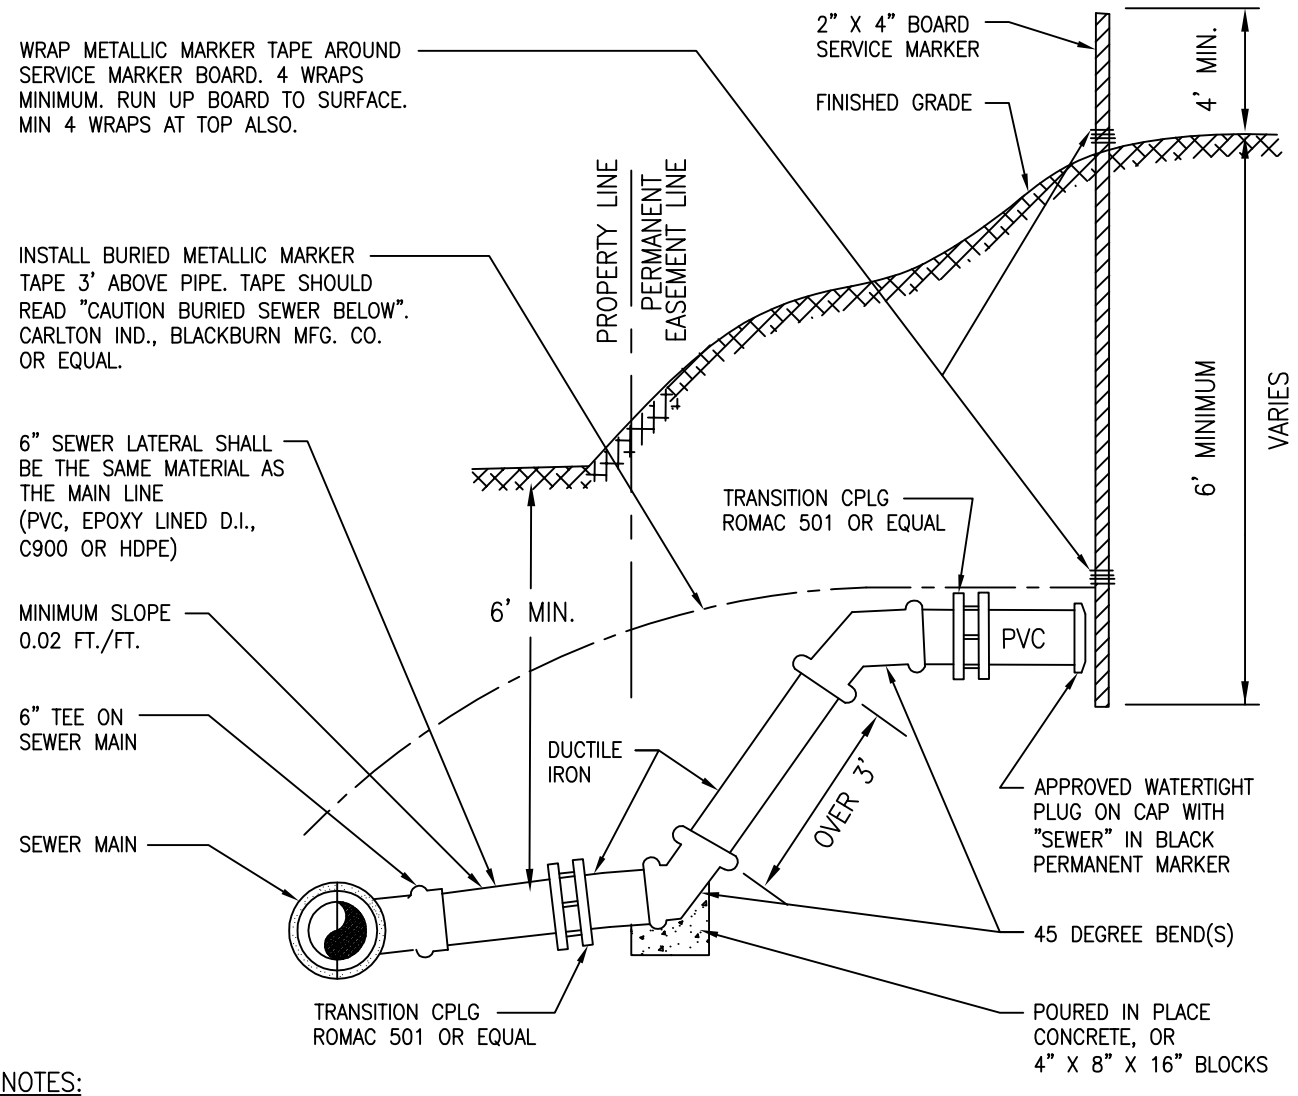

NOTES:

1. 2" X 4" BOARD – LENGTH AS REQUIRED IN EVEN FOOT INCREMENTS. PAINT TOP 5' WITH WHITE PAINT. STENCIL IN BLOCK LETTERS THE WORD "SEWER" & TOTAL LENGTH OF THE 2" X 4" BOARD. LETTERING TO BE 3" IN HEIGHT. TOP OF 2" X 4" SHALL BE 4' ABOVE GROUND LEVEL.
2. IF SLOPE OF PIPE IS OVER 45 DEGREES, AND LENGTH BETWEEN VERTICAL BENDS IS GREATER THAN 3 FEET, TRANSITION TO DUCTILE IRON USING APPROVED GASKETED TRANSITION COUPLINGS.
3. FOR DUCTILE IRON PIPE IN RIGHT-OF-WAY & EASEMENTS, USE RESTRAINING DEVICE AS SPECIFIED BY THE DISTRICT.
4. NO VERTICAL BENDS IN THE RIGHT-OF-WAY OR EASEMENTS.
5. PROVIDE DISTANCE IN FEET FROM TEE TO DOWNSTREAM MANHOLE TO THE DISTRICT.
6. ALTERNATE SEWER LATERAL IS INTENDED FOR THOSE SPECIAL CASES WHERE THE LOCATION AND GRADE OF THE STRUCTURE DOES NOT PROVIDE FOR A NORMAL SEWER INSTALLATION AND SHALL REQUIRE APPROVAL BY THE DISTRICT PRIOR TO INSTALLATION.

ALDERWOOD WATER & WASTEWATER DISTRICT

ALTERNATE SEWER LATERAL NEW CONSTRUCTION

DATE: 11-2015	DWG. S-10A

APPROVED BY: DLH
DISTRICT ENGINEER

NTS